

Lincoln-Pipestone Rural Water Supply - Holland Drinking Water Supply Management Area (DWSMA) MN-00687 - Variable Vulnerability

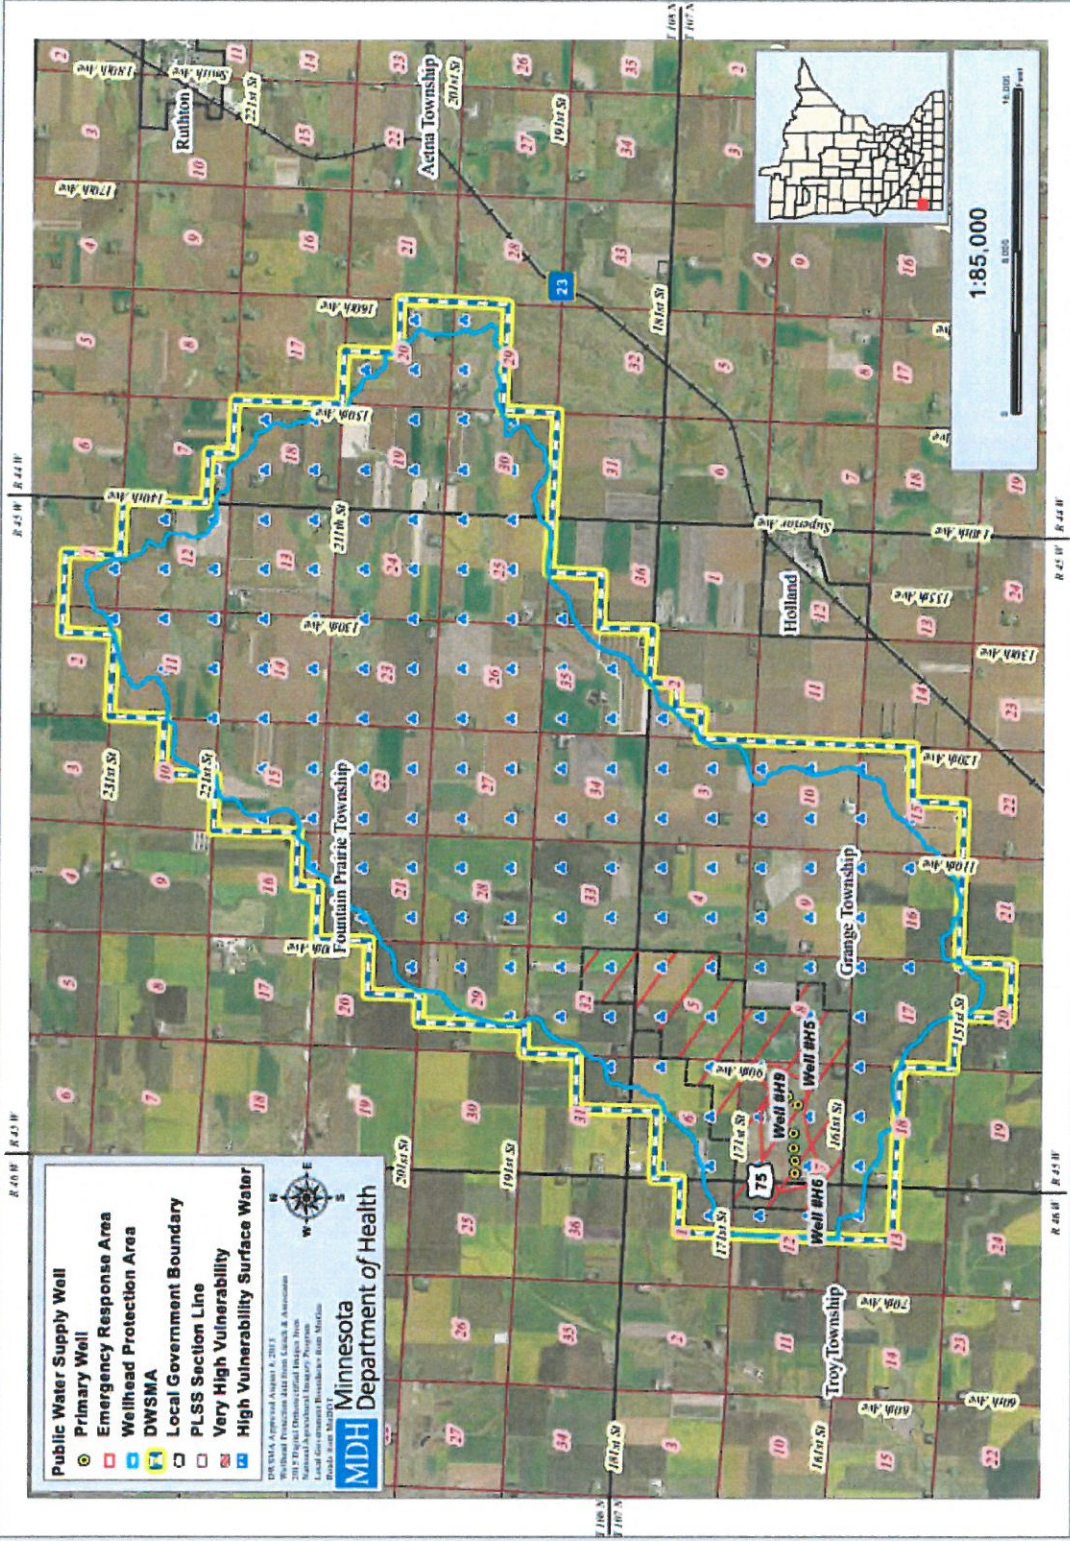


Figure 1 – LPRW Holland Drinking Water Supply Management Area and Vulnerability Assessment

Lincoln-Pipestone Rural Water Supply - North Holland Drinking Water Supply Management Area (DWSMA) MN-00688 - Variable Vulnerability

Drinking Water Supply Management Area (DWSMA) MN-00688 - Variable Vulnerability

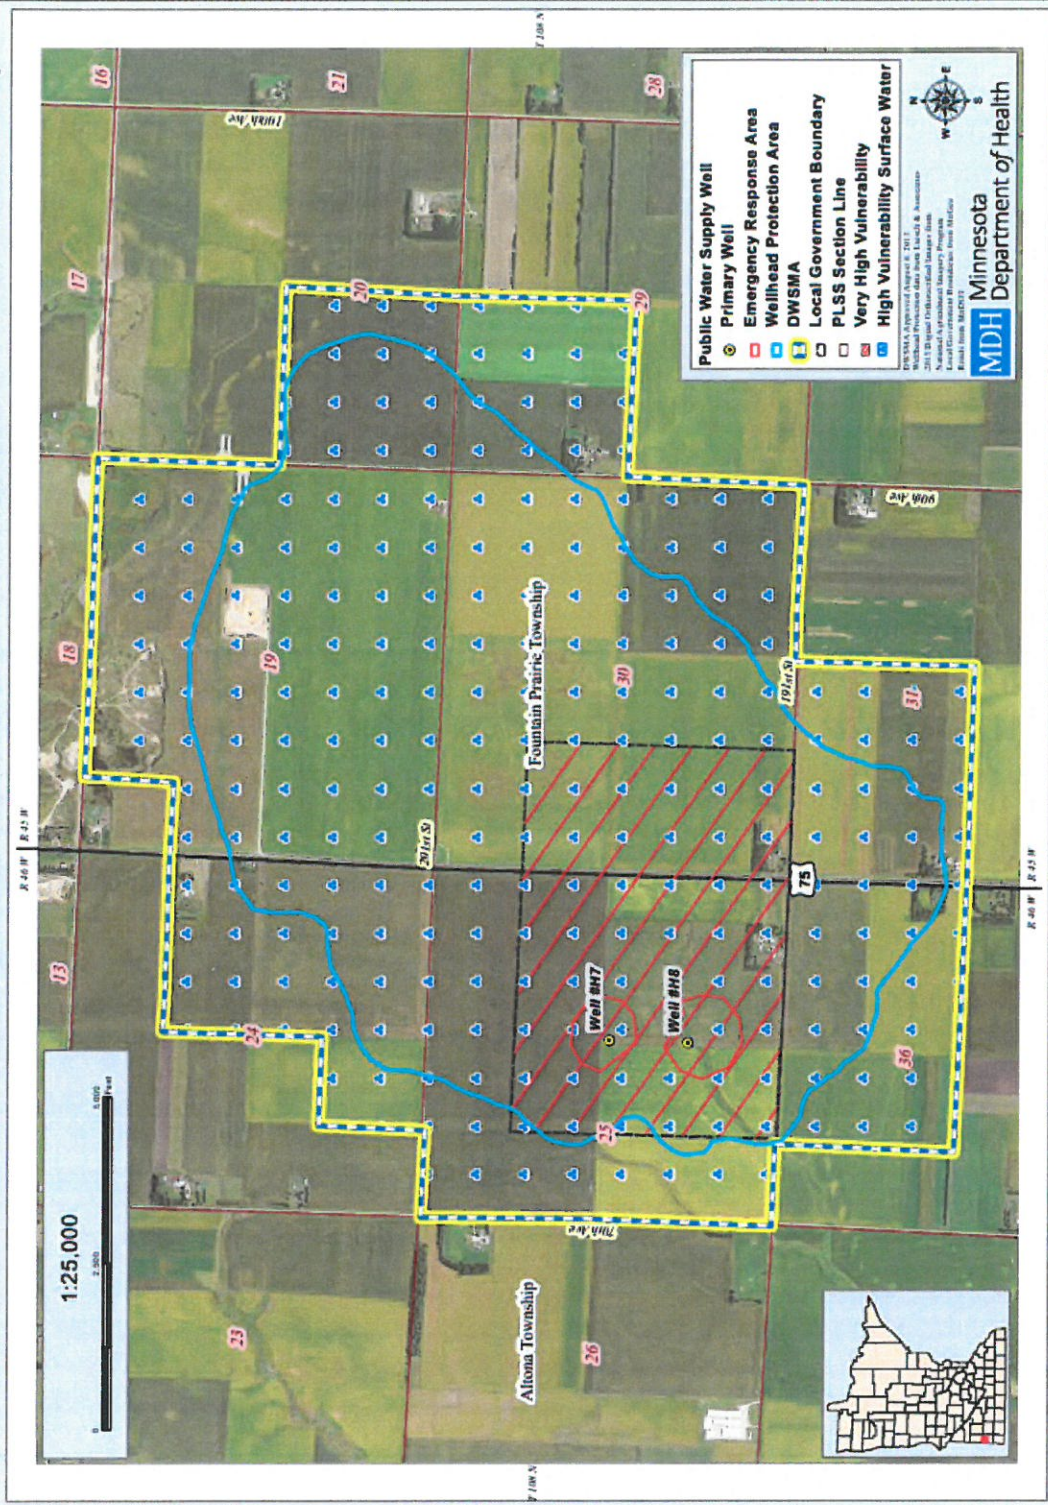


Figure 2 – LPRW North Holland Drinking Water Supply Management Area and Vulnerability Assessment

Lincoln-Pipestone Rural Water Supply - Verdi Drinking Water Supply Management Area (DWSMA) MN-006886 - Variable Vulnerability

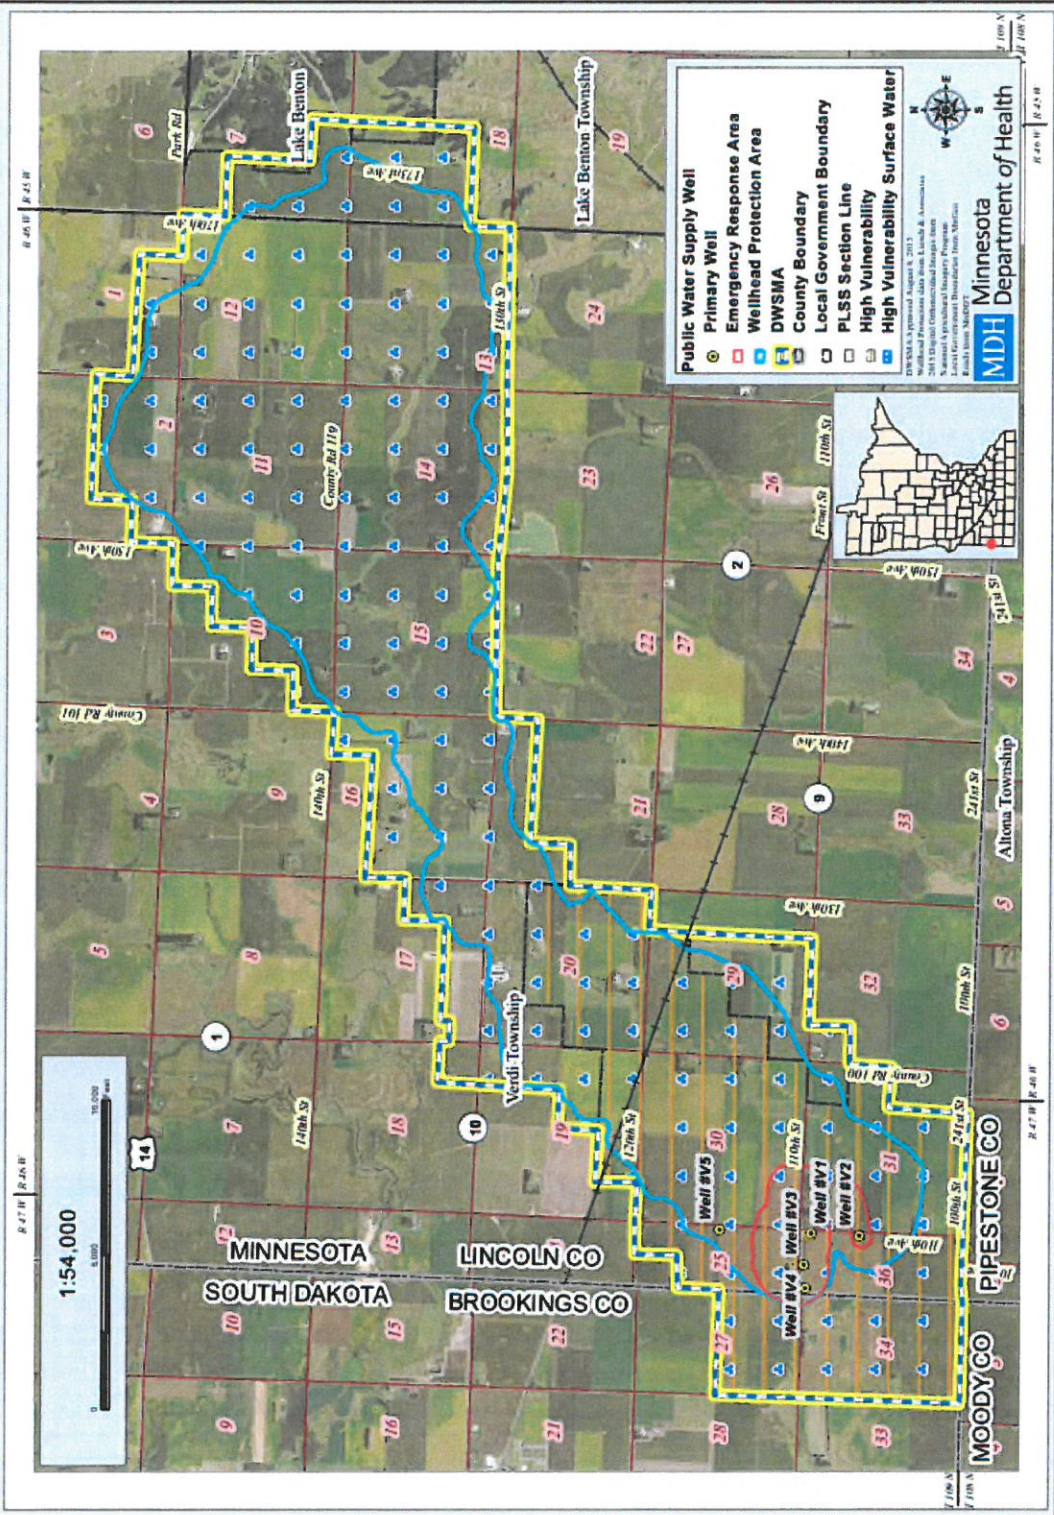


Figure 3 – LPRW Verdi Drinking Water Supply Management Area and Vulnerability Assessment

Lincoln-Pipestone Rural Water Supply - Burr North Drinking Water Supply Management Area (DWSMA) MN-00871 - Variable Vulnerability

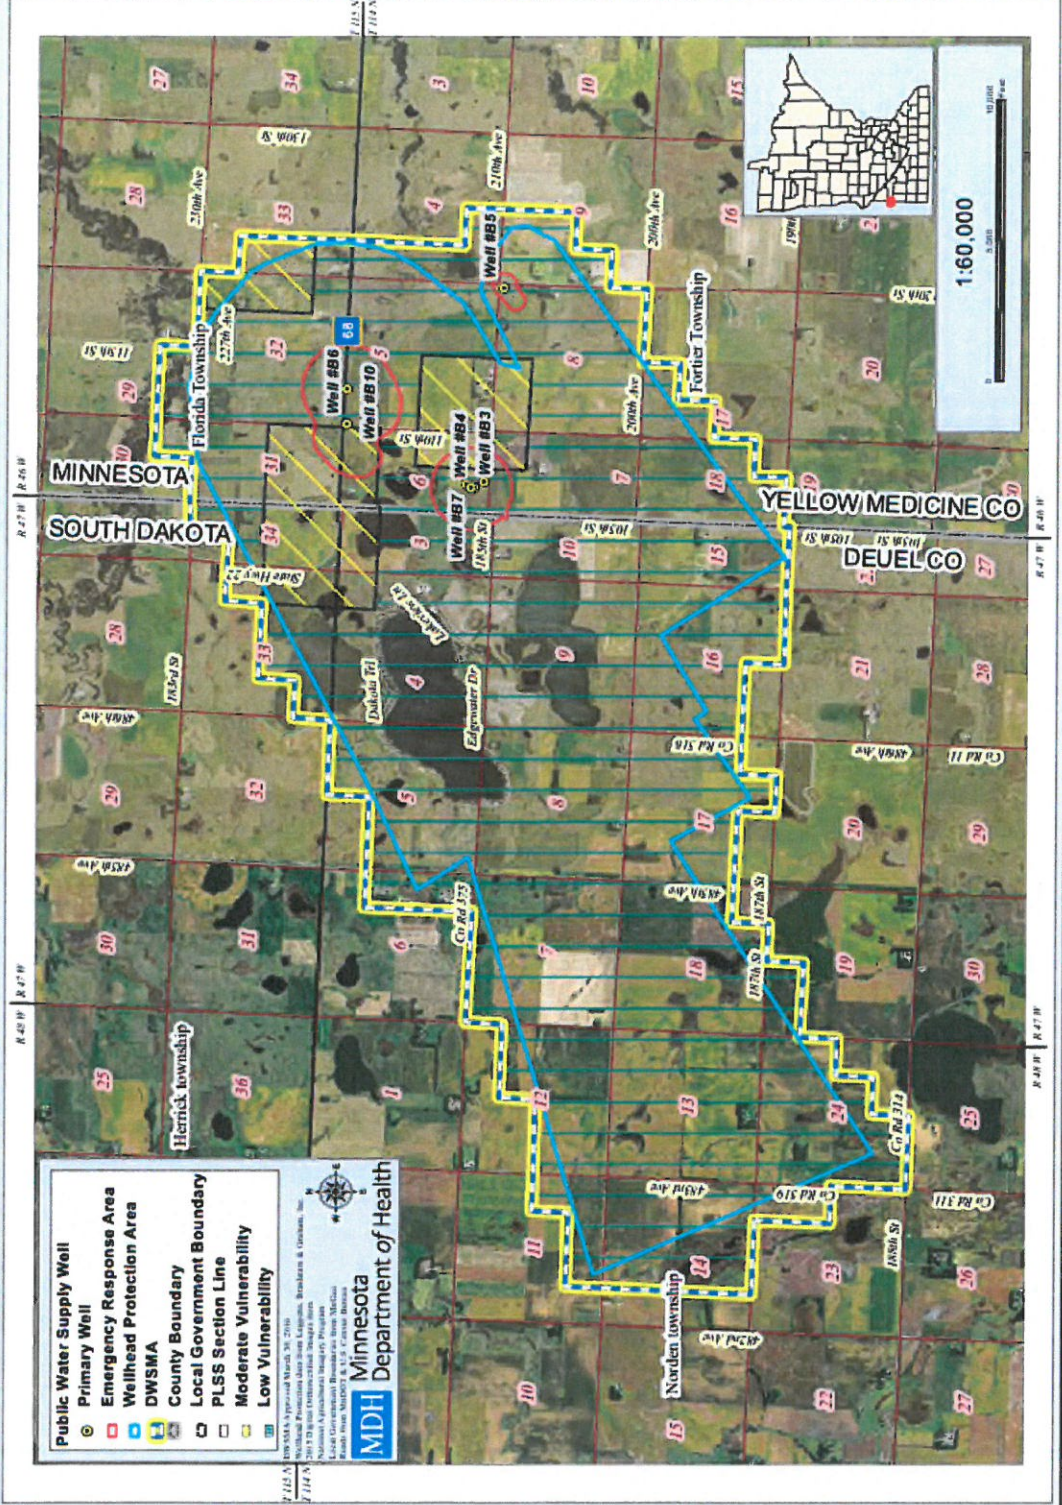


Figure 4 – LPRW Burr North Drinking Water Supply Management Area and Vulnerability Assessment

Lincoln-Pipestone Rural Water Supply - Burr South Drinking Water Supply Management Area (DWSMA) MN-00872 - Low Vulnerability

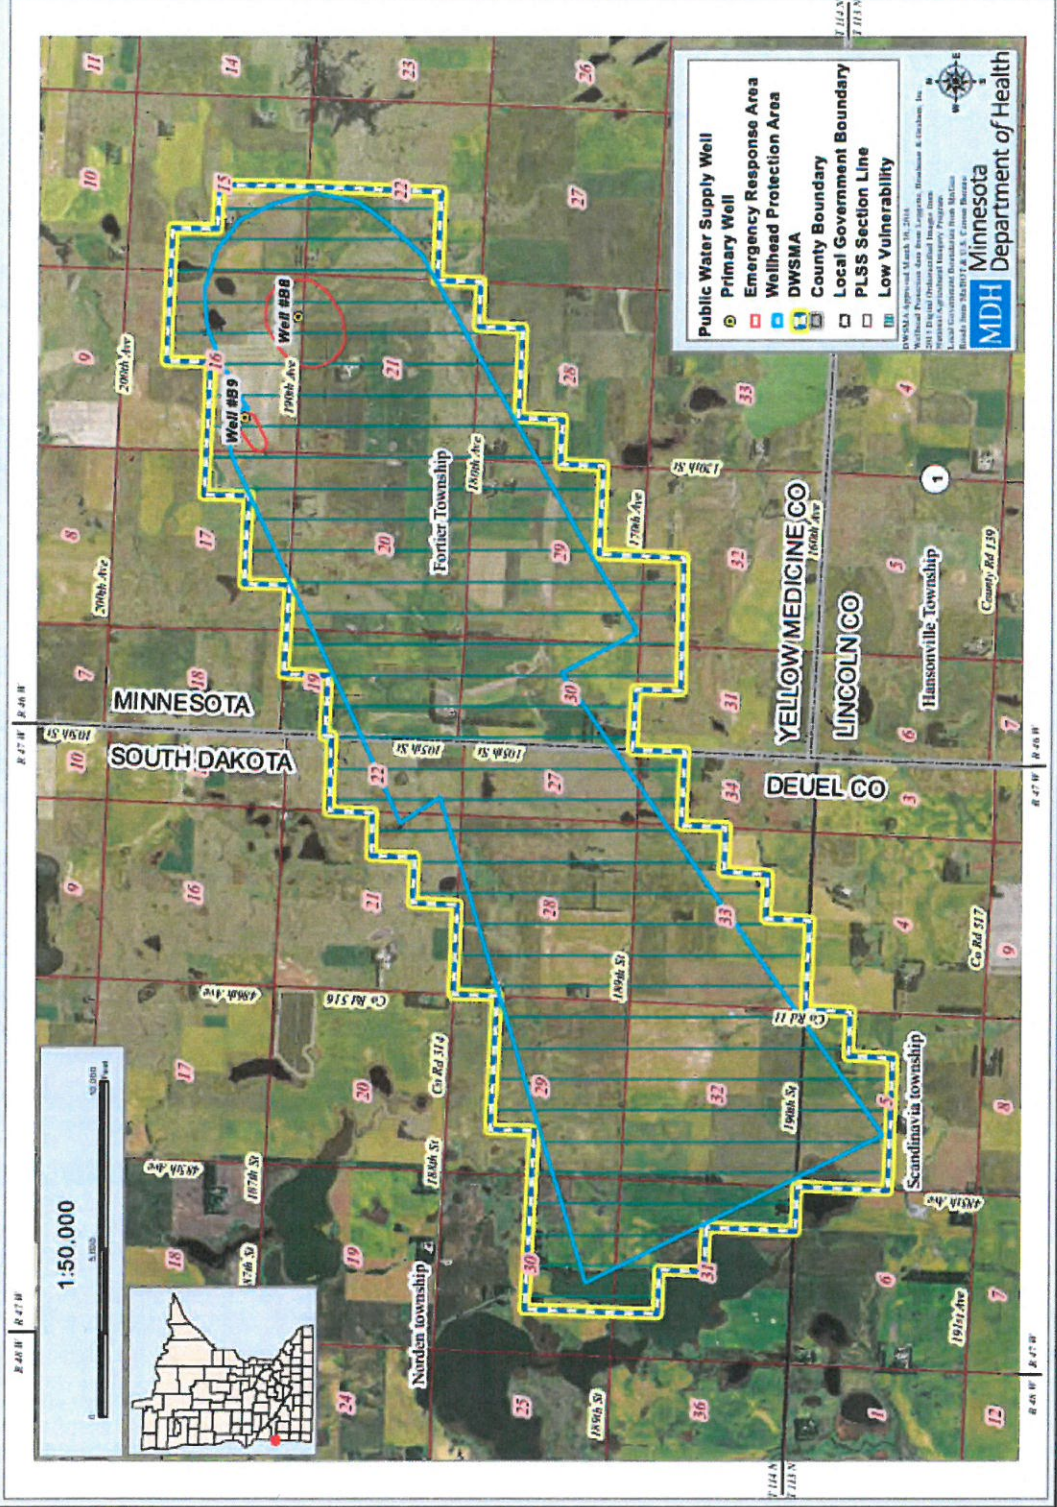


Figure 5 – LPRW Burr South Drinking Water Supply Management Area and Vulnerability Assessment